

**Bill Hansen Catering**  
**Commissary**  
 Miami FL



**Uni-Source Supply**  
 International Inc.  
 2055 W 73rd Street, Miami, FL 33016  
 Ph: (305)826-8696 Fax: (305)826-9131

2	Changes after Site Visit with Bob Stron	12-17-15
3	Added Existing Equipment.	1-13-16
4	Added MEP Information	1-27-16
5	New Hand Sinks, New Hood Drawings, Changed Pot Wash	5-10-16
No.	Revision/Issue	Date

Date  
**May 13, 2016**  
 Drawn By  
**Dayne Gauntlett**  
 Scale  
**1/4" = 1'0"**

Sheet  
**CM-1**

EQUIPMENT SCHEDULE		
ItemNo	Category	Quantity
1	THREE (3) COMPARTMENT SINK	1
2	DISHWASHER, POT/PAN/UTENSIL, DOOR TYPE	1
4	TRAY DRYING RACK	5
5	HOSE REEL	1
6	CHEMICAL STATION	1
7	FLOOR TROUGH	2
8	DISHWASHER, DOOR TYPE	1
9	SOILED DISHTABLE	1
10	CLEAN DISHTABLE	1
21	REACH-IN FREEZER	1
22	ROLL-IN REFRIGERATOR	1
23	REACH-IN REFRIGERATOR	1
24	WORK TABLE	1
	HAND SINK	1
25B	WORK TABLE	2
25C	WORK TABLE	2
25D	WORK TABLE	1
26	WIRE SHELVING	1
27	WORK TABLE	2
	SINK	2
28	REACH-IN FREEZER	1
29	REACH-IN REFRIGERATOR	1
41	ROLL-IN REFRIGERATOR	1
43	WORK TABLE	1
	SINK	1
44	FOOD SLICER	1
51B	FRYER	1
52	CHARBROILER	1
53	RANGE, 60", 10 OPEN BURNERS	1
54	CONVECTION OVEN	1
54B	CONVECTION OVEN	1
55	STOCK POT RANGE, GAS	1
55B	STOCK POT RANGE, GAS	1
56	WORK TABLE	2
57	WORK TABLE	2
58	HAND SINK	3
59	COUNTERTOP GRIDDLE	1
60	KETTLE, GAS, COUNTERTOP	1
	FAUCET	1
61	WIRE SHELVING UNIT	2
	WIRE SHELVING UNIT	1
62	REACH-IN REFRIGERATOR	2
64	PLANETARY MIXER	1
65	WORK TABLE	2
66	WORK TABLE	5
67	ONE (1) COMPARTMENT SINK	1
68	WORK TABLE W/ OS	1
69	MAIN HOOD	1
69.1	EXHAUST FAN	2
69.2	SUPPLY FAN	1
71	WIRE SHELVING UNIT	15
72	WALK-IN COOLER	1
72.1	EVAPORATOR	2
72.2	REMOTE CONDENSER UNIT	1
73	ICE CUBER	1
73.1	ICE BIN FOR ICE MACHINES	1
74	CHEST FREEZER	1
81	WALK-IN COMBO	1
81.1	EVAPORATOR	1
81.2	REMOTE CONDENSER UNIT	1
81.3	EVAPORATOR	1
81.4	REMOTE CONDENSER UNIT	1
82	WIRE SHELVING UNIT	13
	WIRE SHELVING UNIT	2
98	SHELVING, WALL-MOUNTED	11
98B	SHELVING, WALL-MOUNTED	1

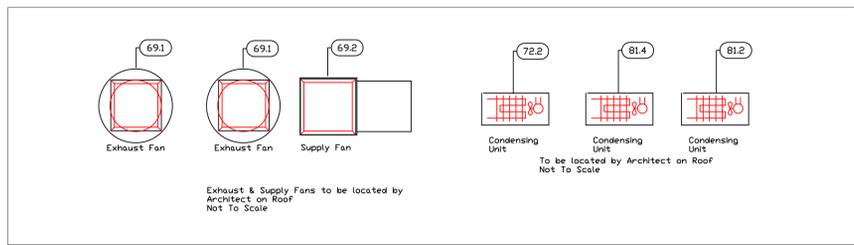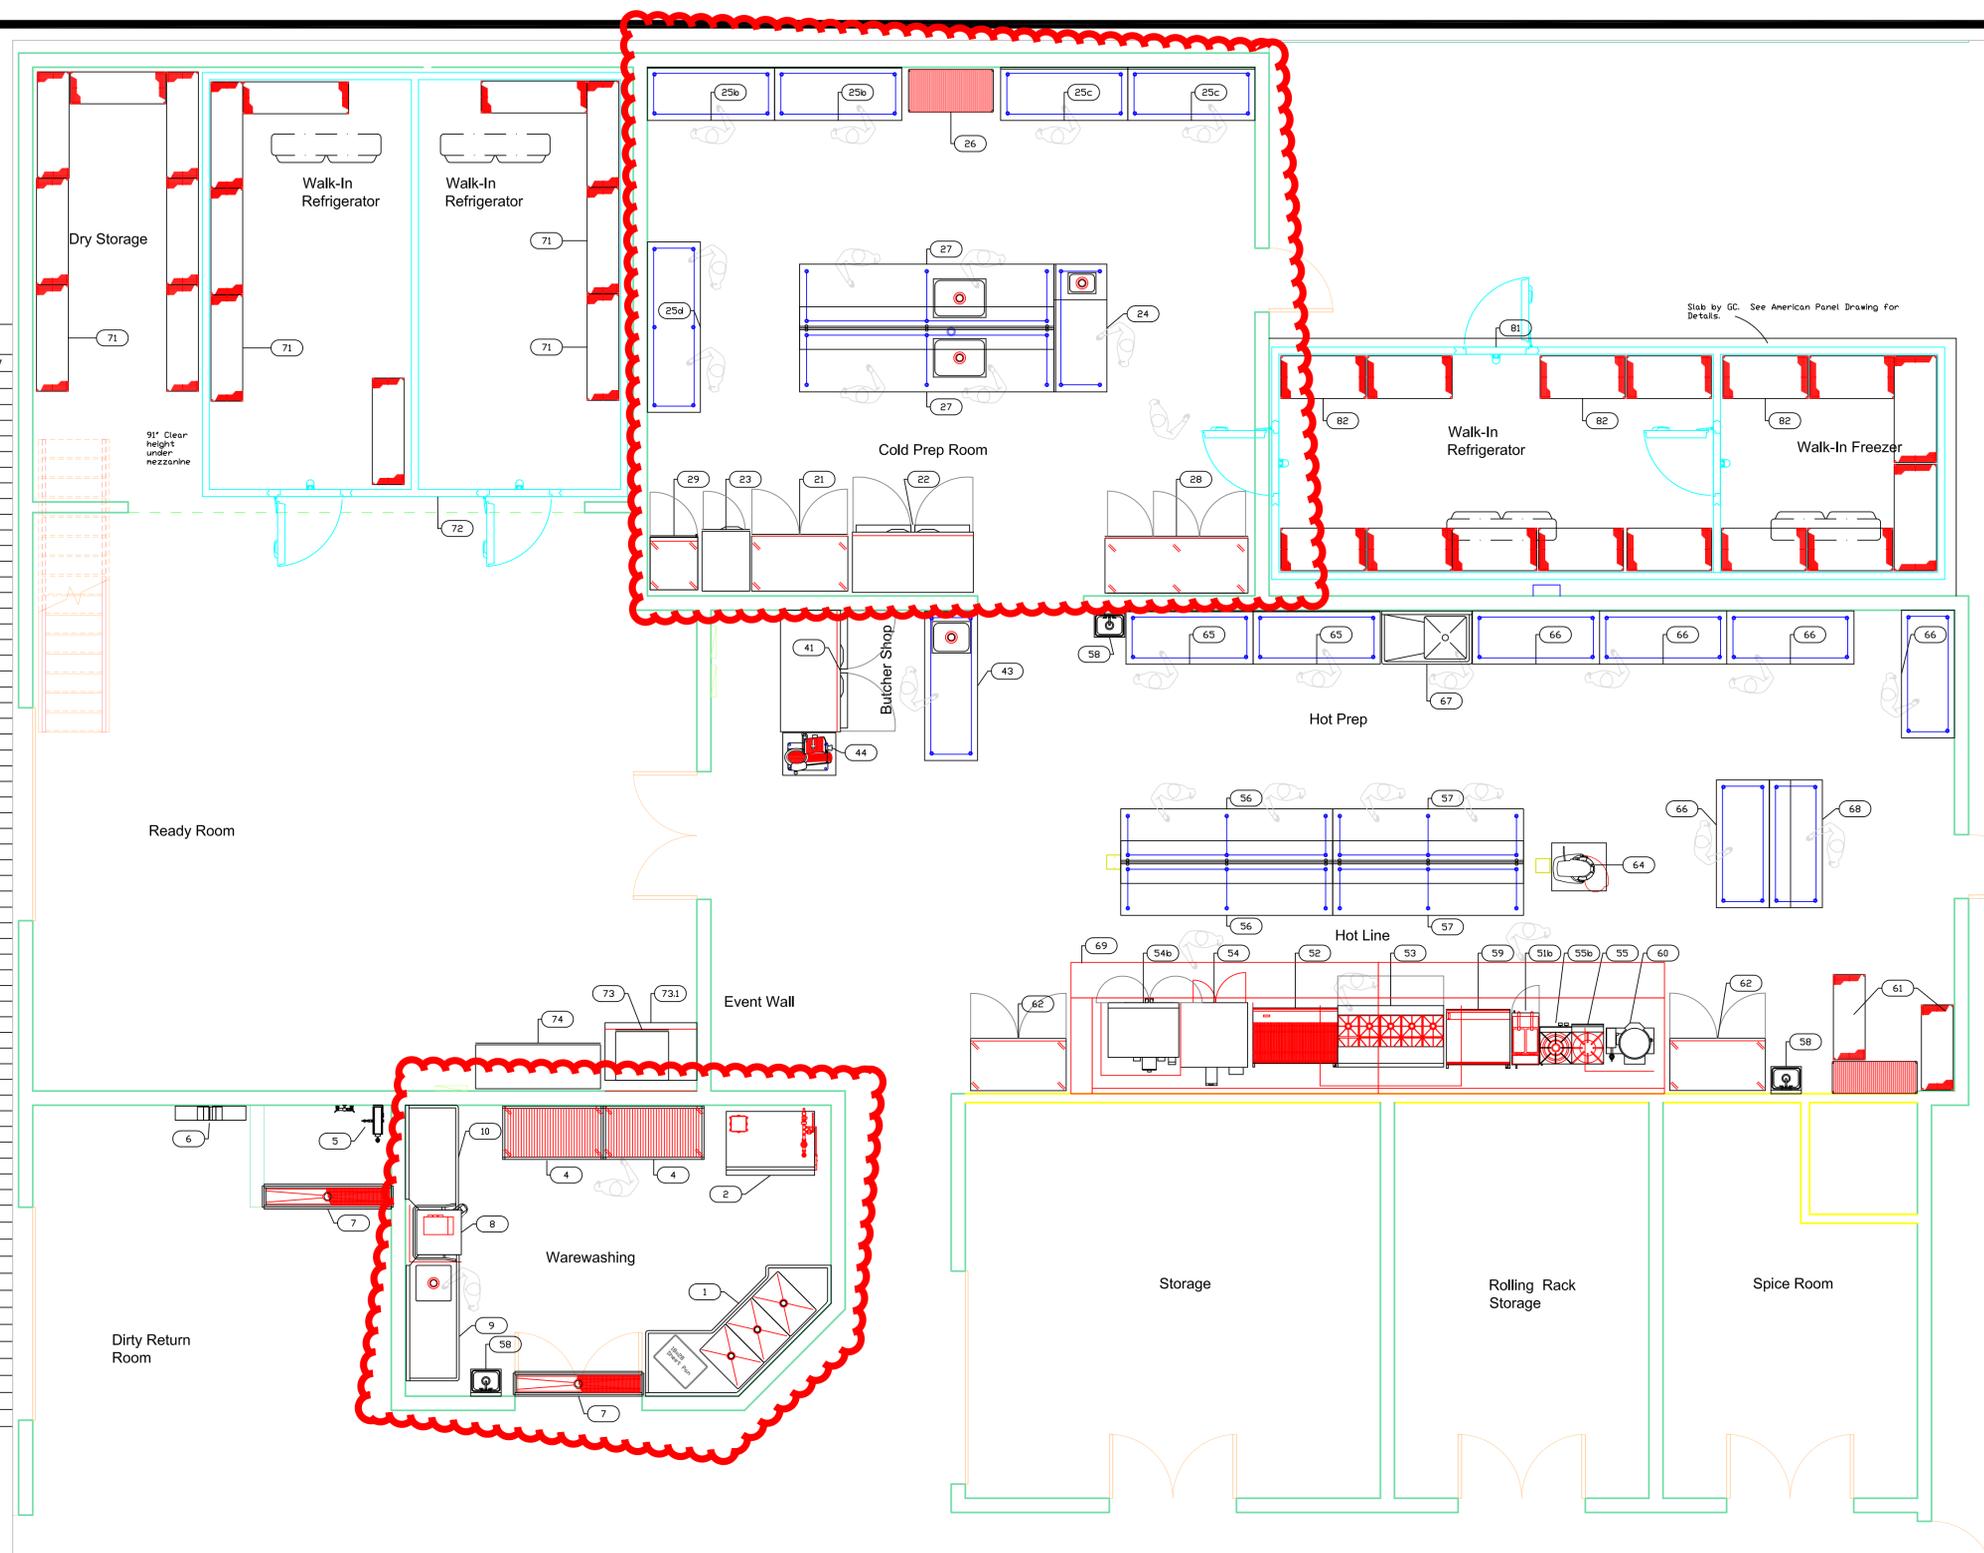

# EQUIPMENT LAYOUT

All Dimensions to be verified on the job site. Actual locations for floor drains, and any ventilating equipment to be determined by Engineer. Mechanical, Plumbing & Electrical to be checked and verified by Customers MEP Engineer. Remote Condensing Units to be located by Architect. Exhaust & Supply fans to be located by Architect.