



1/8" = 1'0"

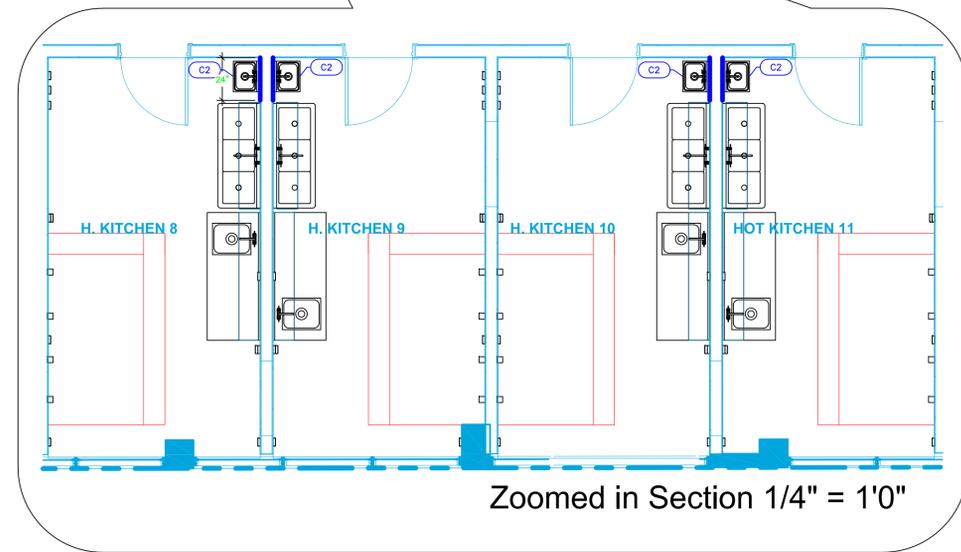

Zoomed in Section 1/4" = 1'0"

Mechanical to Follow

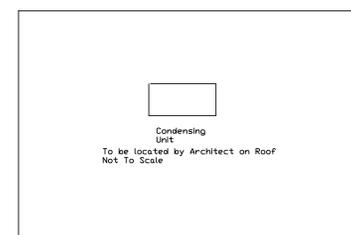





INTERNATIONAL INC.
 2055 W 73rd Street, Miami, FL 33016
 Ph: (305) 826-8696 Fax: (305) 826-9131

2	Update with new background, added storage details	2-4-21
3	Update with new McKenzie background	2-23-21
4	Added MEP Information	3-2-21
5	Kit 1 to cold, kit 23 to hot	6-22-21
No.	Revision/Issue	Date

Date
June 22, 2021
 Drawn By
Dayne Gauntlett
 Scale
 1/8" = 1'0"

Sheet
FS-2.0

- LEGEND - MECHANICAL**
- EXHAUST DUCT COLLAR
 - SUPPLY DUCT COLLAR
 - INWALL BACKING FOR WALL SHELVES
 - RECESSED FLOOR
 - RAISED EQUIPMENT PAD



NOTE # M5: SHOP DRAWING WILL BE PROVIDED BY MANUFACTURER FOR HOOD, EXHAUST FANS, & SUPPLY FANS, UNCE ORDER IS PLACE WITH.

NOTE # M6: ARCHITECT OR ENGINEER TO SIZE AND LOCATE, CONTRACTOR TO PROVIDE ALL OPENINGS FOR DUCTS, PLUMBING LINES, ELECTRICAL LINES, AND REFRIGERATION LINES, AS REQUIRED BY EQUIPMENT.

NOTE # M7: SUPPLY FANS TO BE LOCATED A MINIMUM OF 10' FROM EXHAUST FANS.

NOTE # M8: CEILING HEIGHTS TO BE VERIFIED FOR SUFFICIENT CLEARANCE FOR EQUIPMENT.

NOTE # M9: GENERAL CONTRACTOR TO PROVIDE 1/2" PLYWOOD WALL BACKING FROM 48" TO 78" AFF FOR ALL WALL MOUNTED EQUIPMENT.

NOTE # M10: REFRIGERATION CONTRACTOR TO HANG EVAPORATORS FOR WALK-IN, RUN & CHARGE LINES BETWEEN EVAP. & CONDENSING UNIT.

Equipment MECHANICAL Service Requirements

All Dimensions to be verified on the job site. Actual locations for floor drains, and any ventilating equipment to be determined by Engineer. Mechanical, Plumbing & Electrical to be checked and verified by Customers MEP Engineer. Exhaust & Supply Fans to be located by Architect.