


ELECTRICAL SCHEDULE												
ItemNo	Category	Voltage	Cycle	Phase	Amps	Hp	NEMA	ConnectionType	Rough-In AFF	Quantity	Electrical Remarks	
6	Blender Station	115	60	1	15			Duplex	14"	1	Electrician to connect to Outlet on Equipment	
6.1	Blender, Bar	120	50/60	1	15	3	5-15P	Cord & Plug	na	2	Uses Item #6 Outlet	
8	Work Center	115	60	1	15			Duplex	14"	1		
8.1	POS System	115	60	1	15			Duplex	14"	1	Confirm Requirements with Owner	
								DATA	14"	1	Confirm Requirements with Owner	
9	Refrigerated Work Top	115	60	1	2	1/6	5-15P	Simplex	18"	1		
10	Espresso Cappuccino Machine	208	60	1	30		L6-30P	Simplex	48"	1		
21	Ice Maker with Bin, Cube-Style	115	60	1	5.5		5-15P	Simplex	60"	1		
22	Reach-In Freezer	115	60	1	3.7	1/2	5-15P	Simplex	18"	1		
23	Display Case, Dipping, Gelato	115	60	1				Simplex	18"	1	Electrician to provide electrical whip	

LEGEND -- ELECTRICAL CONNECTIONS

- DUPLEX RECEPT., 15-AMP, 120-VOLT, GROUND TYPE, HORIZONTAL MOUNT
- SIMPLEX RECEPT., 120-VOLT, GROUND TYPE, HORIZONTAL MOUNT
- SPECIAL PURPOSE OUTLET, GROUND TYPE, HORIZONTAL MOUNT
- JUNCTION BOX, DIRECT CONNECTION
- DISCONNECT SWITCH, DIRECT CONNECTION
- FLOOR/CEILING RECEPTACLE AS INDICATED
- (2) Telephone + (2) Data
- FIELD CONNECTIONS
- HARD WIRE CONNECTION POINT AT MACHINE

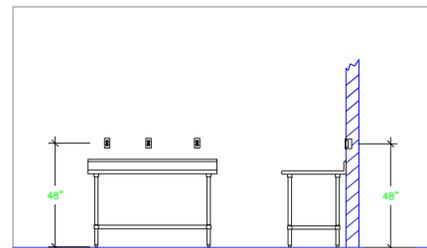

NOTE # E1
TYPICAL OUTLETS IN WALL ABOVE TABLE, BY ELECTRICIAN NOT TO SCALE

NOTE # E2
ALL NATIONAL, STATE, AND LOCAL CODES SHALL APPLY

NOTE # E3
ALL ELECTRICAL CONNECTIONS AND HARDWARE REQUIRED TO BE PROVIDED BY ELECTRICAL CONTRACTOR

NOTE # E4
ALL JUNCTION BOXES, OUTLETS, ETC. TO BE LOCATED SO AS TO NOT INTERFERE WITH EQUIPMENT

NOTE # E5
ALL RELAYS, CONTRACTORS, STARTERS, AND SWITCHES REQUIRED FOR EXHAUST & SUPPLY FANS TO BE PROVIDED BY ELECTRICAL CONTRACTOR UNLESS SPECIFIED

NOTE # E6
ELECTRICAL CONTRACTOR TO INTERCONNECT DISHMACHINE TO EXHAUST FAN FOR DISHMACHINE SO THAT THE FAN RUNS WHEN THE DISHMACHINE IS IN OPERATION.

NOTE # E7
ELECTRICAL CONTRACTOR TO INSTALL TABLE LIMIT SWITCH TO END OF CLEAN DISHTABLE TO THAT MACHINE STOPS WHEN SWITCH IS DEPRESSED.

NOTE # E8
ELECTRICAL CONTRACTOR TO CONNECT DRAIN LINE HEATER, PAN HEATER AND DODR HEATER FOR WALK-IN FREEZER.

Equipment ELECTRICAL Service Requirements

All Dimensions to be verified on the job site. Actual locations for floor drains, and any ventilating equipment to be determined by Engineer. Mechanical, Plumbing & Electrical to be checked and verified by Customers MEP Engineer. Remote Condensing Units to be located by Architect. Exhaust & Supply fans to be located by Architect.

**City Zero
Juice Bar
Miami, Florida**



INTERNATIONAL INC.
2055 W 73rd Street, Miami, FL 33016
Ph:(305)826-8696 Fax:(305)826-9131

No.	Revision/Issue	Date
1	Preliminary Layout	11-16-19
2	Update based on new backgrounds	12-19-19
3	Update based on 1-15-20 conference call.	1-16-20
4	Moved 3 bowl sink.	12-17-20

Date
Dec 17, 2020
Drawn By
Dayne Gauntlett
Scale
1/2" = 1'0"

Sheet
FS-3