









| ITEM NO. | QTY | DESCRIPTION                         | EXHAUST (L X W) | EXHAUST (CFM) | SUPPLY (L X W) | SUPPLY (CFM) | Ventilation Remarks          | Unit |
|----------|-----|-------------------------------------|-----------------|---------------|----------------|--------------|------------------------------|------|
| L3       | 4   | Cabinet Hard Mount Washer Extractor | 4"              | 220           |                |              | Reinforced Concrete Pad      | ea   |
| L4       | 1   | Stacke Washer Dryer                 | 8"              | 800           |                |              | Venting Location by Engineer | ea   |
| L8       | 4   | Electric Dryer                      | 4"              | 220           |                |              | Venting Location by Engineer | ea   |
| S1       | 5   | Stacke Washer Dryer                 |                 |               |                |              |                              |      |

**Mechanical Schedule**

| EXHAUST (L X W) | EXHAUST (CFM) | SUPPLY (L X W) | SUPPLY (CFM) | Ventilation Remarks          | Unit |
|-----------------|---------------|----------------|--------------|------------------------------|------|
| 4"              | 220           |                |              | Reinforced Concrete Pad      | ea   |
| 8"              | 800           |                |              | Venting Location by Engineer | ea   |
| 4"              | 220           |                |              | Venting Location by Engineer | ea   |

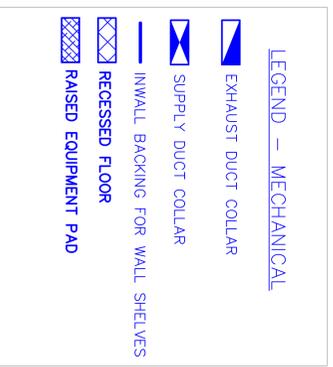

Typical Dry Enclosure  
\*\*Not to Scale\*\*

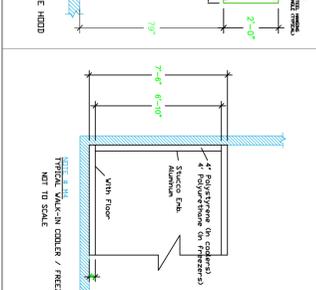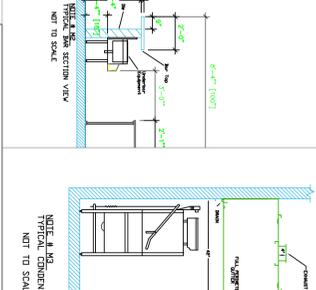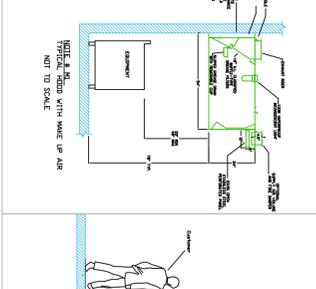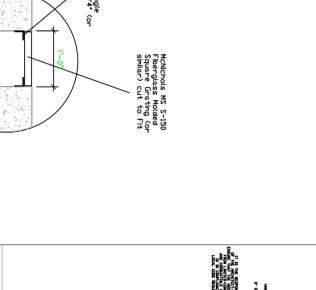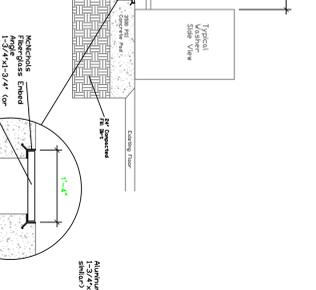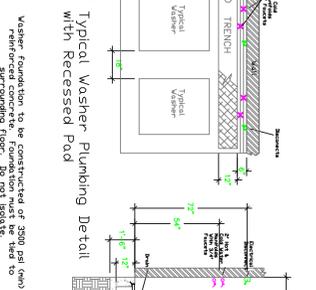

Typical Floor Drain  
Furnished & Installed by P.C.

Through Screen Detail  
Not to Scale  
Furnished & Installed by P.C.

NOTE: ALL SUPPLY FANS TO BE LOCATED A MINIMUM OF 10' FROM EXHAUST FANS.

NOTE: ALL GENERAL CONTRACTOR TO PROVIDE MANUFACTURER FOR FANS, DUCT, BRICK IS MADE BY THE CONTRACTOR TO BE CHECKED BY ENGINEER.

NOTE: ALL SUPPLY FANS TO BE VERIFIED FOR SUFFICIENT CLEARANCE FOR EQUIPMENT.

NOTE: ALL MECHANICAL CONTRACTOR TO PROVIDE MANUFACTURER FOR FANS, DUCT, BRICK IS MADE BY THE CONTRACTOR TO BE CHECKED BY ENGINEER.

NOTE: ALL SUPPLY FANS TO BE VERIFIED FOR SUFFICIENT CLEARANCE FOR EQUIPMENT.

**Equipment MECHANICAL Service Requirements**

All Dimensions to be verified on the job site. Actual locations for floor drains, and any ventilating equipment to be determined by Engineer, Mechanical, Plumbing & Electrical to be checked and verified by Customers MEP Engineer. Remote Condensing Units to be located by Architect. Exhaust & Supply fans to be located by Architect.



INTERNATIONAL INC.  
2055 W 73rd Street, Miami, FL 33016  
Ph:(305)826-8696 Fax:(305)826-9131



**Molo Resorts**  
**Laundry**  
**Providenciales, T&C**

|     |                                  |          |
|-----|----------------------------------|----------|
| No. | Revision/Issue                   | Date     |
| 2   | Update after ownership comments. | 5-1-25   |
| 3   | Update after ownership comments. | 6-27-25  |
| 4   | Added Modifications              | 6-30-25  |
| 5   | Added MEP                        | 10-12-26 |

Date: Jan 12, 2026  
Drawn By: Dayne Gauntlett  
Scale: 3/8" = 1'0"

Sheet: L-2.1